


$^1\text{H-NMR}$

Product No. D4508


2,4-Dichloro- α -methylbenzyl Alcohol



Solvent : CDCl_3

Internal Standard : $\text{Si}(\text{CH}_3)_4$


Measured Temperature : 21.4°C

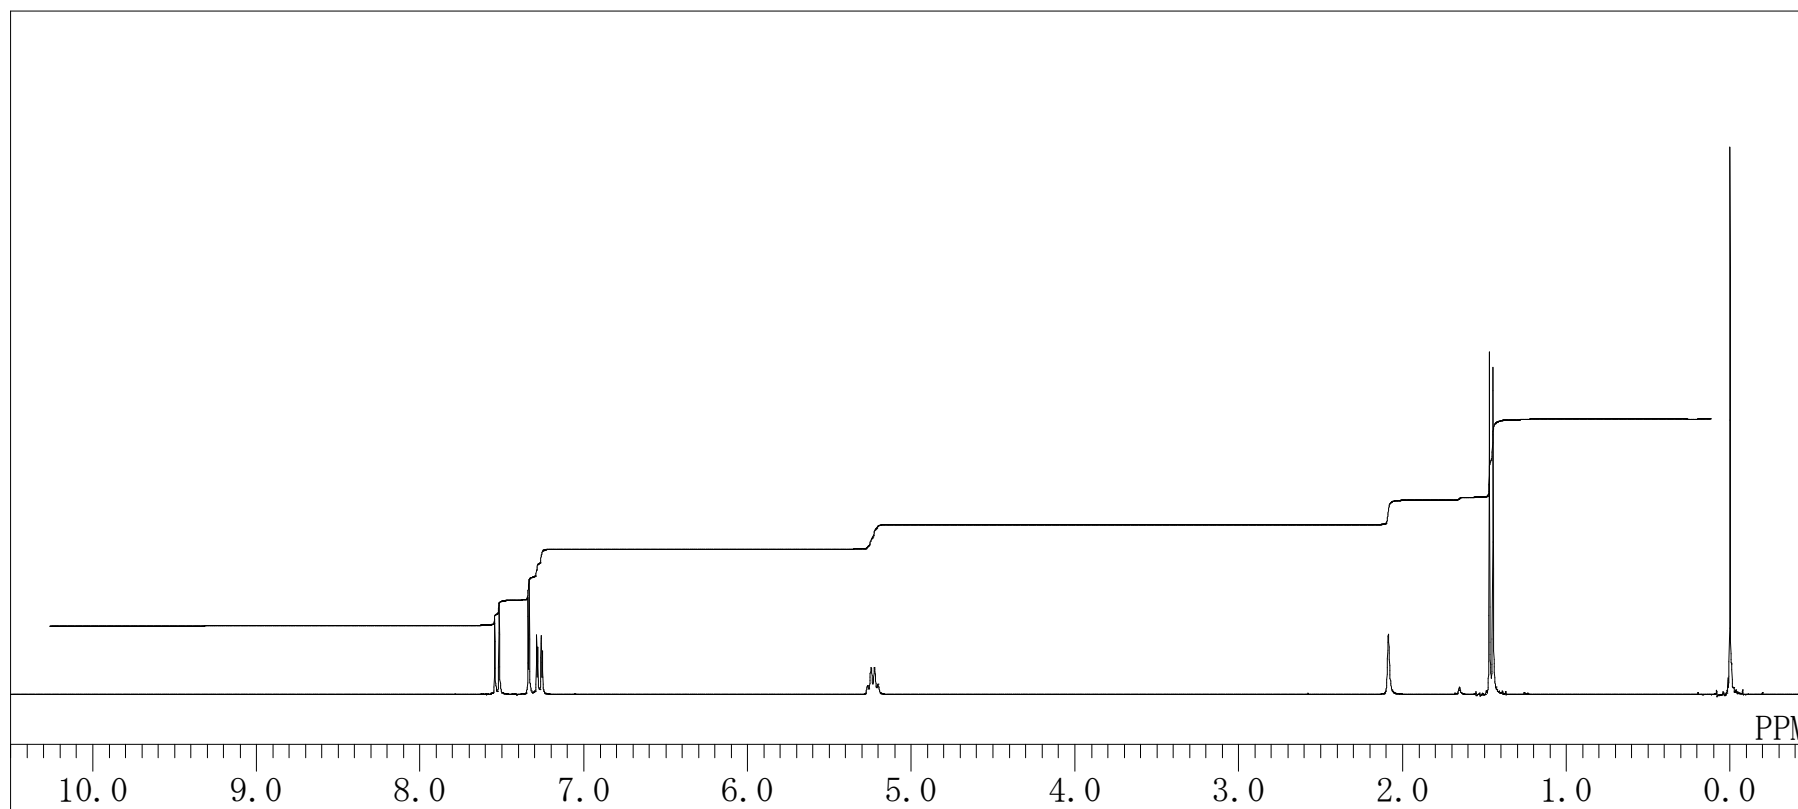

^{13}C -NMR

Product No. D4508

2,4-Dichloro- α -methylbenzyl Alcohol



Solvent : CDCl_3

Internal Standard : CDCl_3

Measured Temperature : 22.9°C

